

EXCELL RAILING SYSTEMS LTD. TEST REPORT

SCOPE OF WORK

REPORT OF EXCELL RAILING SYSTEMS LTD. 2-1/2 IN. SURFACE MOUNTED POST KIT – 6 FT.
RAILING SYSTEM TESTED IN ACCORDANCE WITH ASTM E935-21, *STANDARD TEST METHODS
FOR PERFORMANCE OF PERMANENT METAL RAILING SYSTEMS AND RAILS FOR BUILDINGS*

REPORT NUMBER

106144599COQ-002

TEST DATES

05/07/25

ISSUE DATE

06/20/25


PAGES

17

DOCUMENT CONTROL NUMBER

GFT-OP-10c (09/29/20)

© 2020 INTERTEK

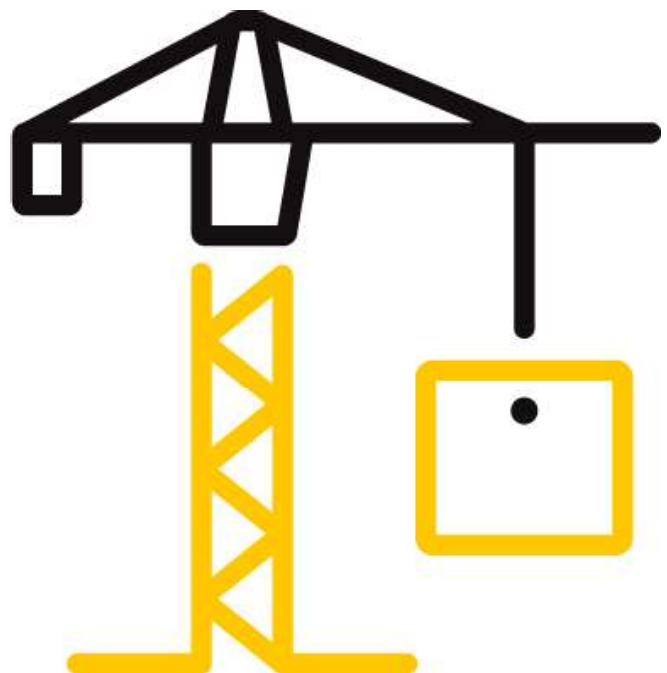

TEST REPORT FOR EXCELL RAILING SYSTEMS LTD.

Report No.: 106144599COQ-002

Date: 06/20/25

REPORT ISSUED TO

EXCELL RAILING SYSTEMS LTD.

#306 – 12886 Anvil Way
Surrey, BC, V3W 8E7
Canada

SECTION 1

SCOPE

Intertek Building & Construction (B&C) was contracted by Excell Railing Systems Ltd., #306 – 12886 Anvil Way, Surrey, BC, V3W 8E7, Canada, to perform testing on the 2-1/2 in. Surface Mounted Post Kit – 6 ft. Railing System in accordance with ASTM E935-21, *Standard Test Methods for Performance of Permanent Metal Railing Systems and Rails for Buildings*. The scope of the testing as requested by Excell Railing Systems Ltd., was to assess the ability of the guard system to resist the load requirements of Section 1607.9 of the 2024 IBC and R301.5 of the 2024 IRC. Results obtained are tested values and were secured by using the designated test method(s). Testing was conducted at the Intertek test facility in Coquitlam, BC, Canada on May 7, 2025.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

For INTERTEK B&C:

COMPLETED			
BY:	Chris Chang, P.Eng.	REVIEWED BY:	Baldeep Sandhu
TITLE:	Senior Technician – Building & Construction	TITLE:	Manager – Building & Construction
SIGNATURE:		SIGNATURE:	
DATE:	06/20/25	DATE:	06/20/25

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

TEST REPORT FOR EXCELL RAILING SYSTEMS LTD.

Report No.: 106144599COQ-002

Date: 06/20/25

SECTION 2

SUMMARY OF TEST RESULTS

SYSTEM DESCRIPTION	TEST	PASS/FAIL
2-1/2 in. Surface Mounted Post Kit – 6 ft. Railing System	In-fill Load	Pass
	Uniform Load	Pass
	Horizontal – Mid-Span Concentrated Load	Pass
	Horizontal – Adjacent to Post Concentrated Load	Pass
	Horizontal – Top of Post Concentrated Load	Pass

Refer to Appendix B for photos of testing.

TEST REPORT FOR EXCELL RAILING SYSTEMS LTD.

Report No.: 106144599COQ-002

Date: 06/20/25

SECTION 3

TEST METHOD

The guard specimen was evaluated in accordance with the following:

ASTM E935-21, *Standard Test Methods for Performance of Permanent Metal Railing Systems and Rails for Buildings*.

The required test loads were based on the Specified Loads per the following Building Code articles with the Safety Factors applied as indicated in this report.

2024 International Building Code (IBC)

- Section 1607.9 *Loads on Handrails, Guards, Grab Bars and Seats*

2024 International Residential Code (IRC)

- R301.5 *Live Load*

SECTION 4

MATERIAL SOURCE

The client submitted the railing system to the Evaluation Center on April 9, 2025 (Coquitlam ID# VAN2504091520-001). The sample was received in good condition and was suitable for testing unless noted otherwise. The sample was not independently selected for testing.